

Catalog Number: 124TB

Item Description:200A 4T RT OUUPC Code:784572102453

Brand Name: Milbank

Type: Ring Type Meter Socket

Application: Meter Socket

Standard: UL Listed

Voltage Rating: Up to 240 Volts Alternating Current

Amperage Rating: 200 Continuous Ampere

Phase: 1 Phase

Frequency Rating: 60 Hertz

Number Of Cutouts: 0

Cable Entry: Overhead and Underground

Terminal: Single Mechanical Line Side and Single

Mechanical Load Side Connector


Mounting: Surface Mount

Enclosure: Type 3R, G90 Galvanized Steel with

Powder Coat Finish




FEATURE TABLE			
ITEM	QTY	DESCRIPTION	
Α	1	1/4 SOLID K.O.	
В	1	1/4, 1/2 CONC. K.O.	
С	3	3/4, 1, 11/4, 11/2, 2, 21/2 CONC. K.O.	
D	3	1¼, 1½, 2, 2½, 3 CONC. K.O.	

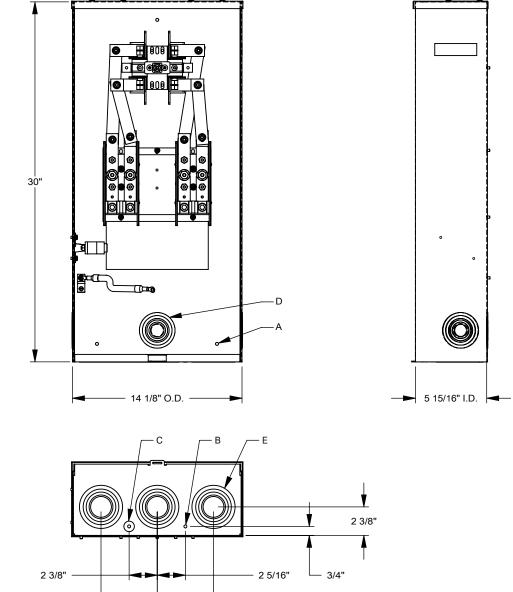

- 4 11/16"

4 11/16" —

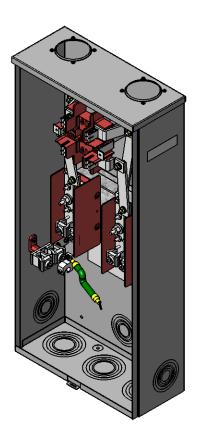



Version:

All dimensions are +/- 1/16". Drawing views are not to scale.

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.



Catalog Number: 124TB

Item Description:200A 4T RT OUUPC Code:784572102453

Brand Name: Milbank

Type: Ring Type Meter Socket

Application: Meter Socket

Standard: UL Listed

Voltage Rating: Up to 240 Volts Alternating Current

Amperage Rating: 200 Continuous Ampere

Phase: 1 Phase

Frequency Rating: 60 Hertz

Number Of Cutouts: 0

Cable Entry: Overhead and Underground

Terminal: Single Mechanical Line Side and Single

Mechanical Load Side Connector


Mounting: Surface Mount

Enclosure: Type 3R, G90 Galvanized Steel with

Powder Coat Finish




FEATURE TABLE			
ITEM	QTY	DESCRIPTION	
Α	1	1/4 SOLID K.O.	
В	1	1/4, 1/2 CONC. K.O.	
С	3	3/4, 1, 11/4, 11/2, 2, 21/2 CONC. K.O.	
D	3	1¼, 1½, 2, 2½, 3 CONC. K.O.	

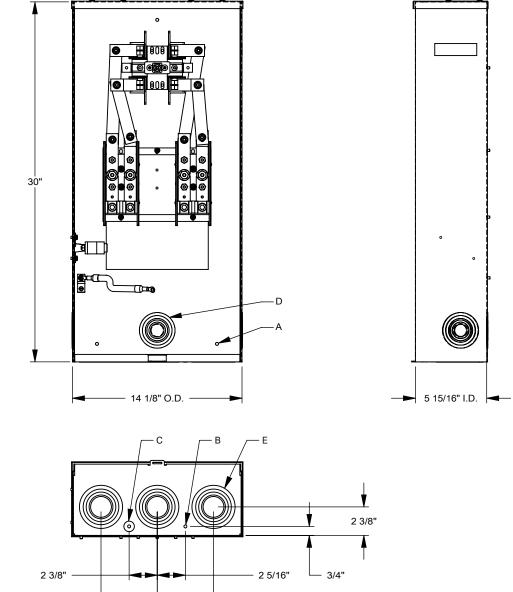

- 4 11/16"

4 11/16" —

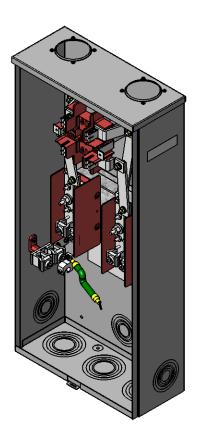



Version:

All dimensions are +/- 1/16". Drawing views are not to scale.

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.