

Catalog Number: U1256-X

Item Description: 200A 4T RL 6P CTR WY

**UPC Code:** 784572133846

Brand Name: Milbank

Type: Ringless Meter Socket

**Application:** Meter Socket

Standard: UL Listed

Voltage Rating: 300 Volts Alternating Current

Amperage Rating: 200 Continuous Ampere

Phase: 1 Phase

Frequency Rating: 60 Hertz

Number Of Cutouts: 0

Cable Entry: Overhead and Underground, Center

Wireway

**Terminal:** 3/8 Inch Line Side and Lay in Load Side

Mounting: Surface Mount


Enclosure: Type 3R, G90 Galvanized Steel with


Powder Coat Finish


Additional Specifications: Number of Jaws:4 Terminal


Hub Opening and Closing Plates:Large Closing Plate





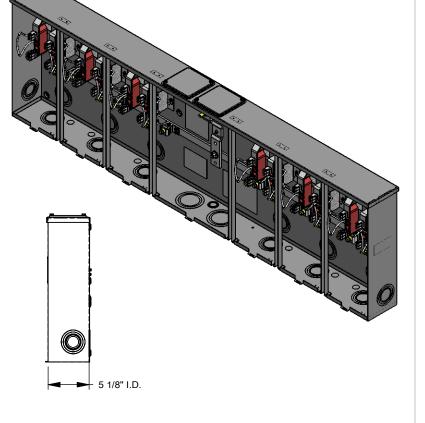

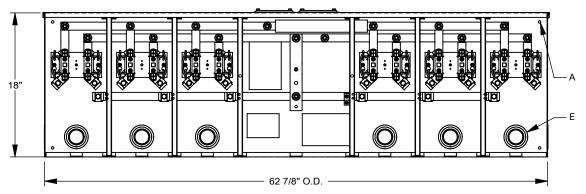

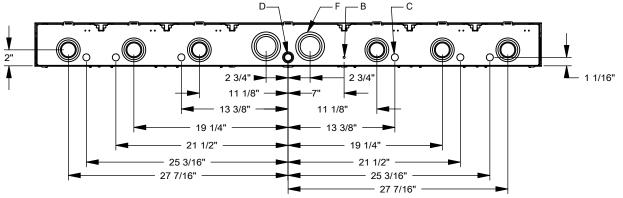



Version:

All dimensions are +/- 1/16". Drawing views are not to scale.

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.

1



Catalog Number: U1256-X

Item Description: 200A 4T RL 6P CTR WY

**UPC Code:** 784572133846

Brand Name: Milbank

Type: Ringless Meter Socket

**Application:** Meter Socket

Standard: UL Listed

Voltage Rating: 300 Volts Alternating Current

Amperage Rating: 200 Continuous Ampere

Phase: 1 Phase

Frequency Rating: 60 Hertz

Number Of Cutouts: 0

Cable Entry: Overhead and Underground, Center

Wireway

**Terminal:** 3/8 Inch Line Side and Lay in Load Side

Mounting: Surface Mount


Enclosure: Type 3R, G90 Galvanized Steel with


Powder Coat Finish


Additional Specifications: Number of Jaws:4 Terminal


Hub Opening and Closing Plates:Large Closing Plate





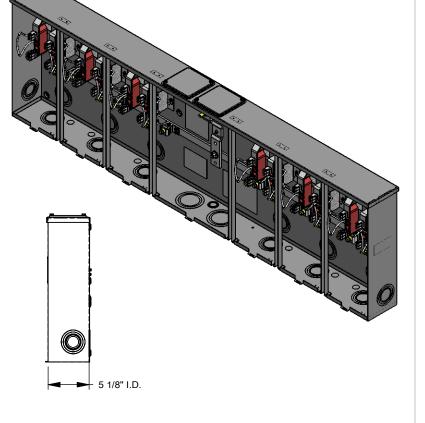

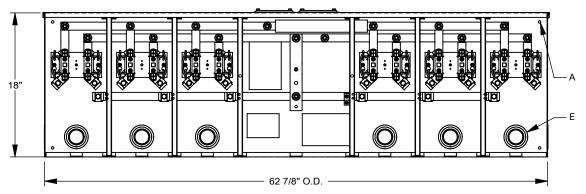

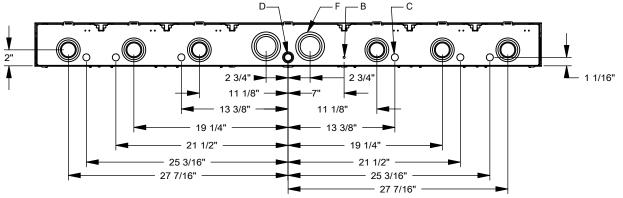



Version:

All dimensions are +/- 1/16". Drawing views are not to scale.

Utility requirements for this equipment may vary. Always consult the serving utility for their requirements prior to ordering or installing this equipment. This product must be installed by a licensed electrician. Installation of this equipment may require local electrical inspector approval.

1